



NOTES:
 SEPTIC FIELD DESIGN MEETS YUKON SPECIFICATIONS FOR SOIL ABSORPTION SYSTEMS.
 SEPTIC TANKS SHALL CONFORM TO CAN/CSA-B66-M90
 PVC PIPE SHALL CONFORM TO B182.1M
 DESIGN BASIS
 GOLDER ASSOCIATES REPORT HYDROGEOLOGICAL ASSESSMENT AND FEASIBILITY STUDY
 DESIGN PARAMETERS
 DESIGN FLOW RATE = 400 IMP. GAL/DAY FOR 8 PEOPLE OR 150 GAL. FOR 3 PEOPLE
 PERCOLATION RATE = 55 MIN./ INCH
 DESIGN DETAIL

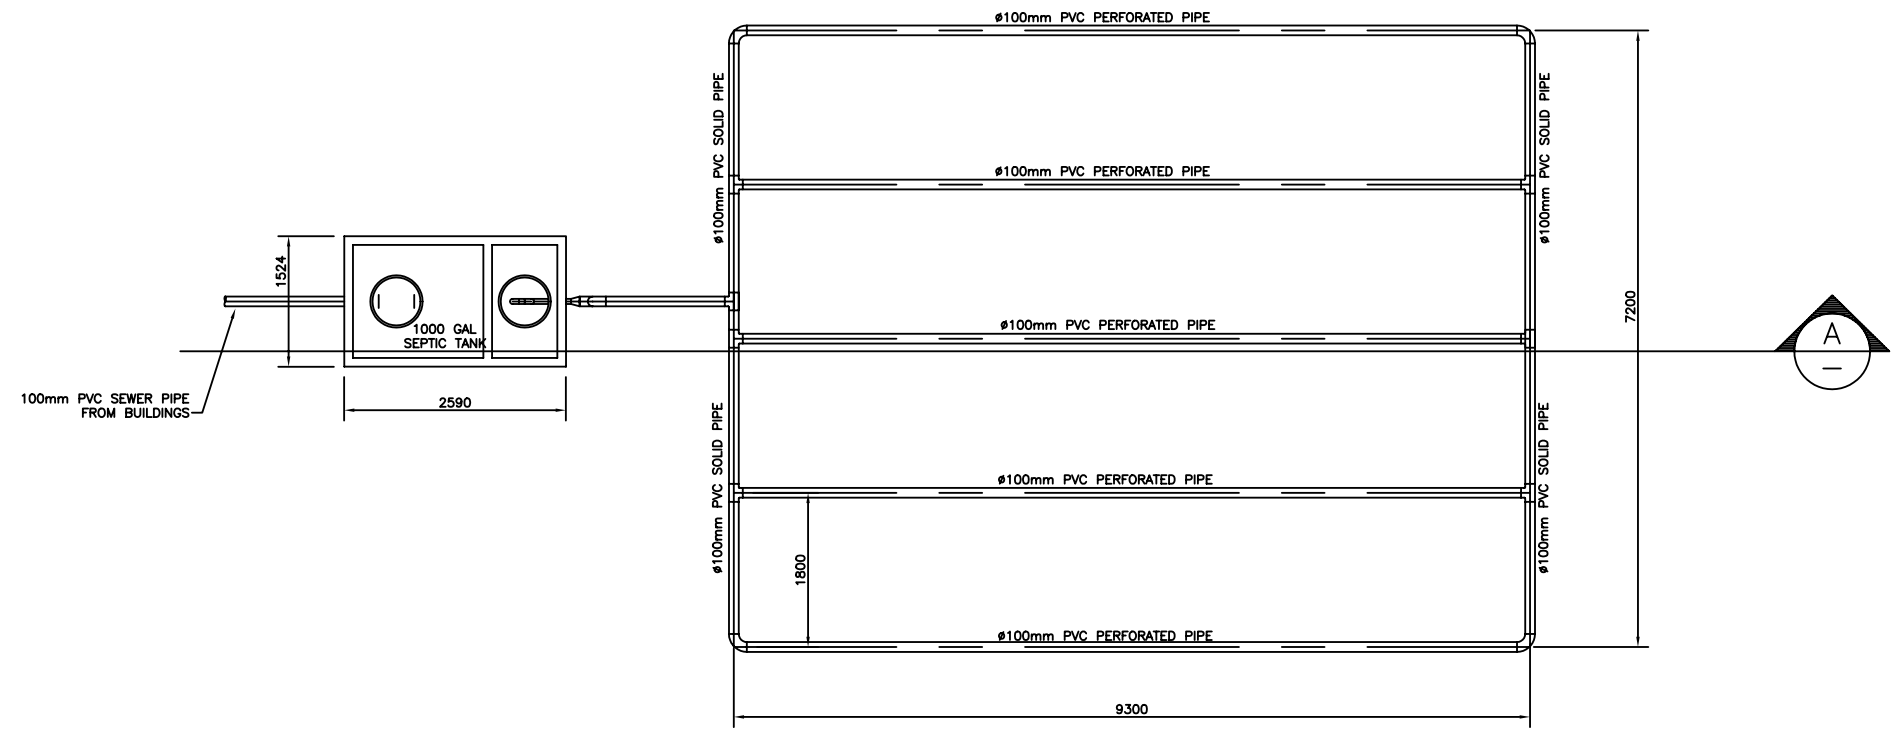

DETAILED PLAN VIEW

SCALE 1:40

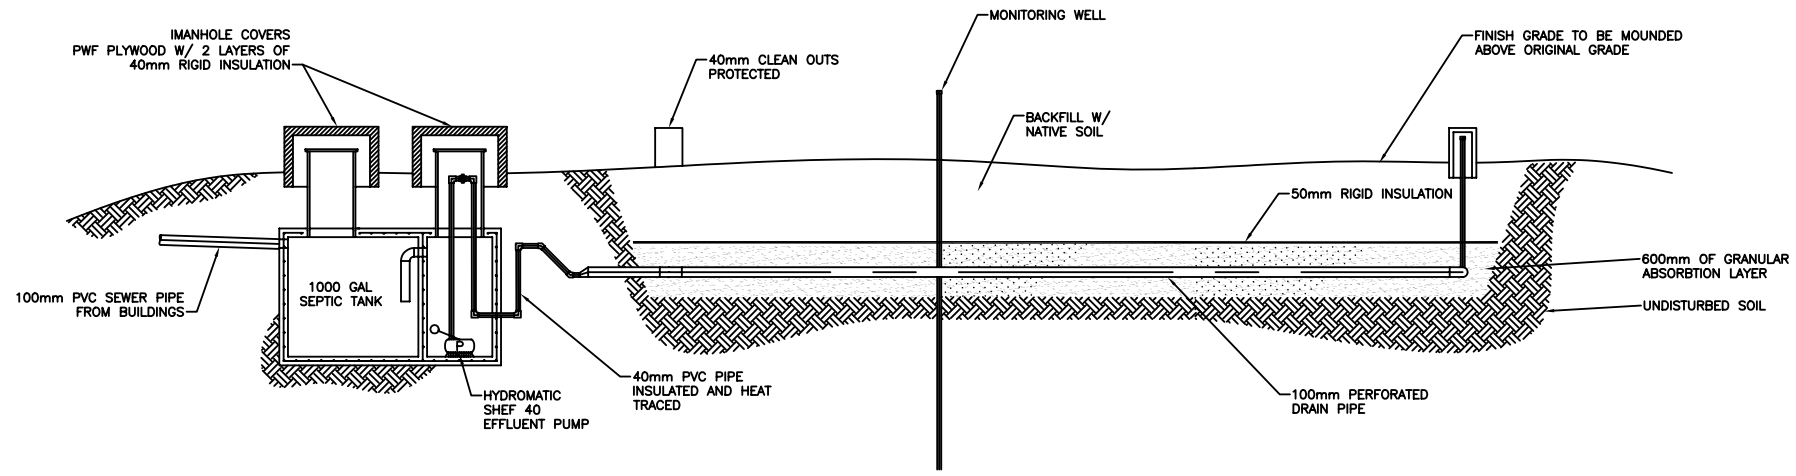

SECTION A

SCALE 1:40

										PROFESSIONAL STAMP	PERMIT STAMP	LOCATION BLUEFISH LAKE NWT			
										TITLE 2005 CONSTRUCTION NEW TRANSIENT TRAILER WATER AND SEWER SEPTIC FIELD					
DRAWING NO.	TITLE	0	ORIGINAL	111-5013	MH	06/05						SCALE NTS	SHEET 1 of 1	DRAWING NO.	REV. O
REFERENCE DRAWINGS		REVISION LETTER	REVISION	WORK ORDER	NAME	DATE	CHECKED BY	DESIGNED BY	STATUS OF DRAWING	DATE					

AUTOCAD FILE:

PLOT SCALE:

6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17