


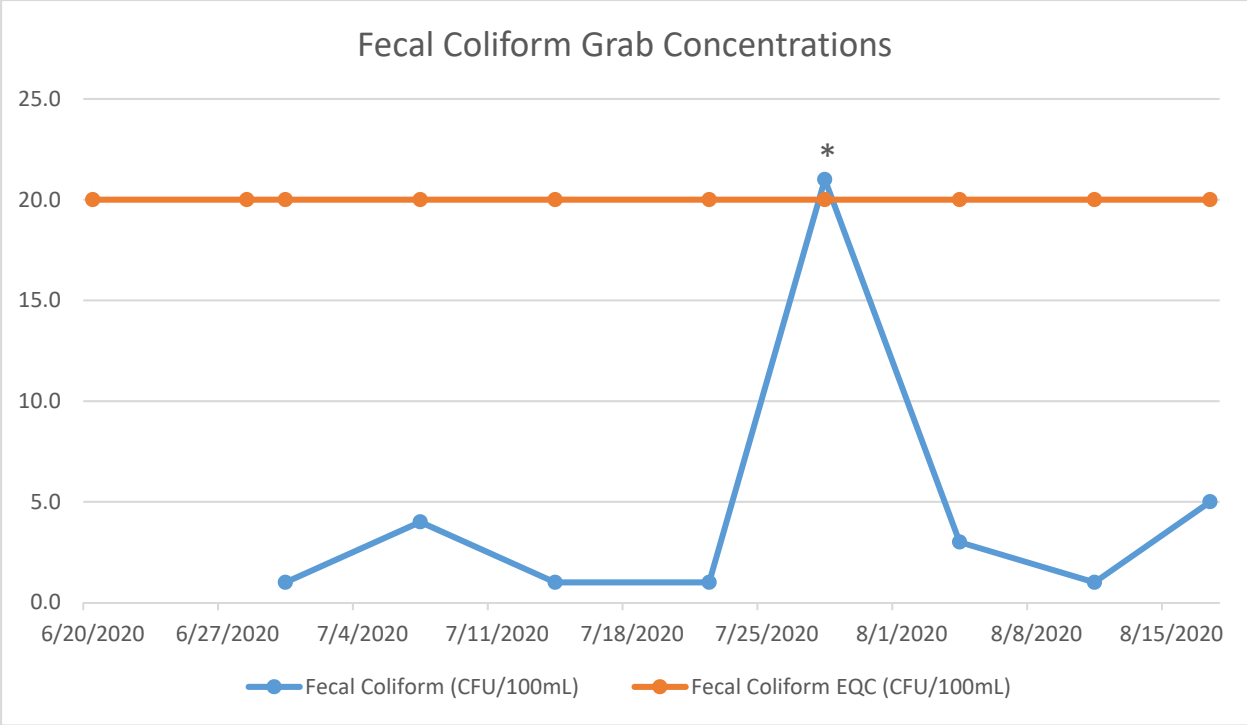



Appendix IV Graphical Summary of 2020 SNP Water Quality Data with EQC's

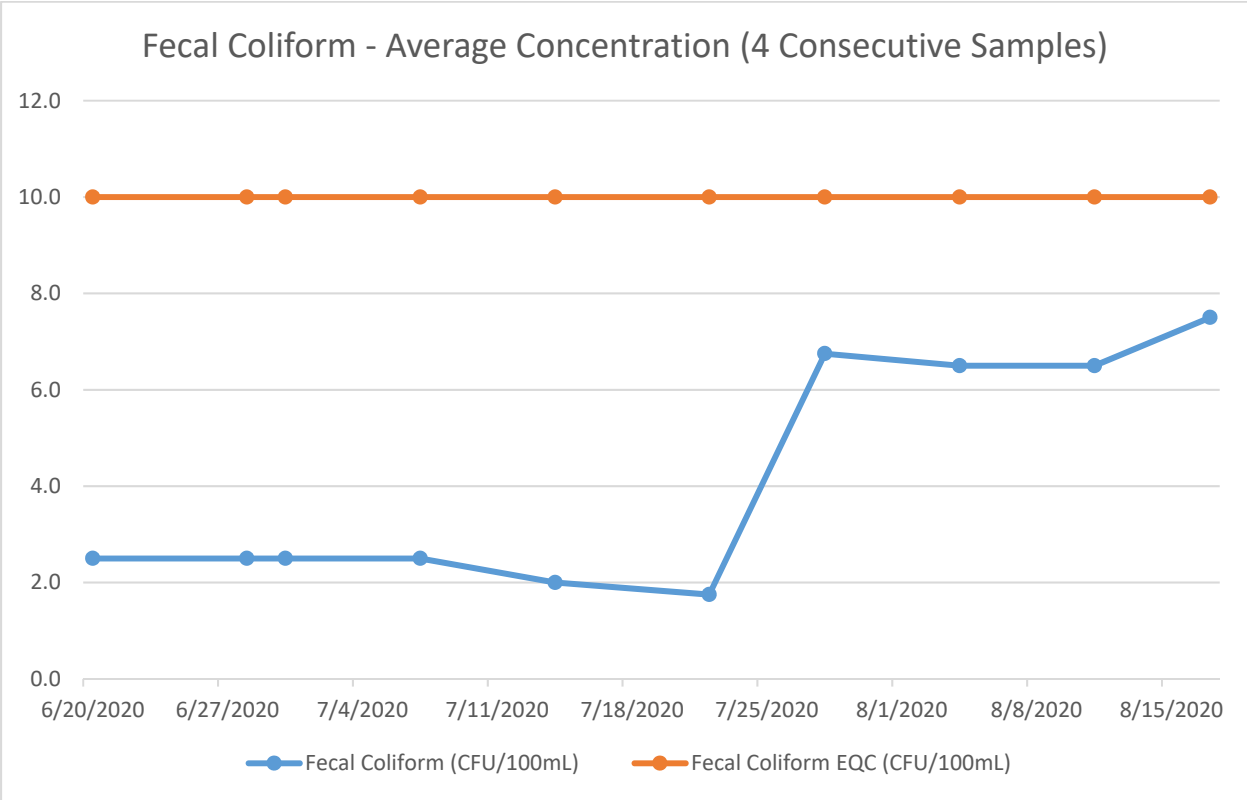


* The Inspector was notified as per Water Licence MV2019L2-0004 Part B, Condition #22 of an exceedance of fecal coliforms at SNP 02-17b that occurred during the July 28th, 2020 sampling

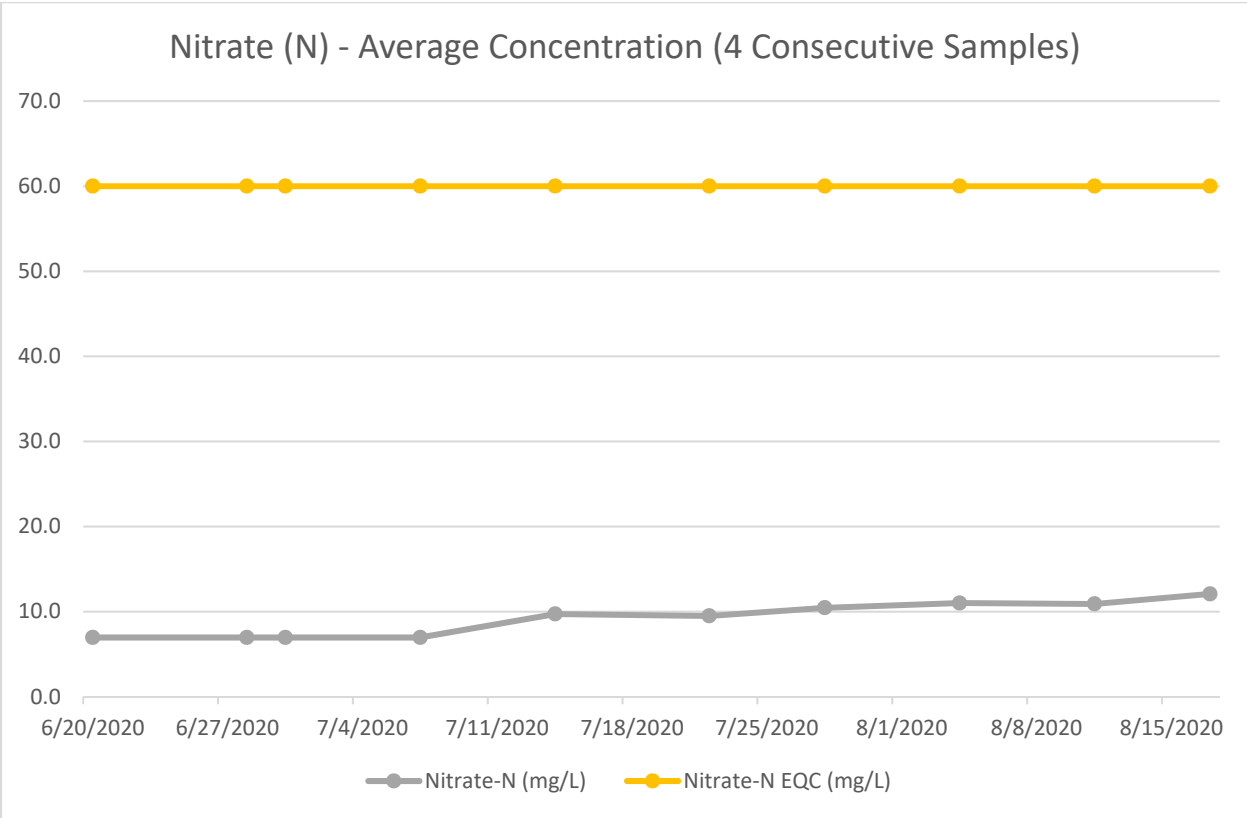

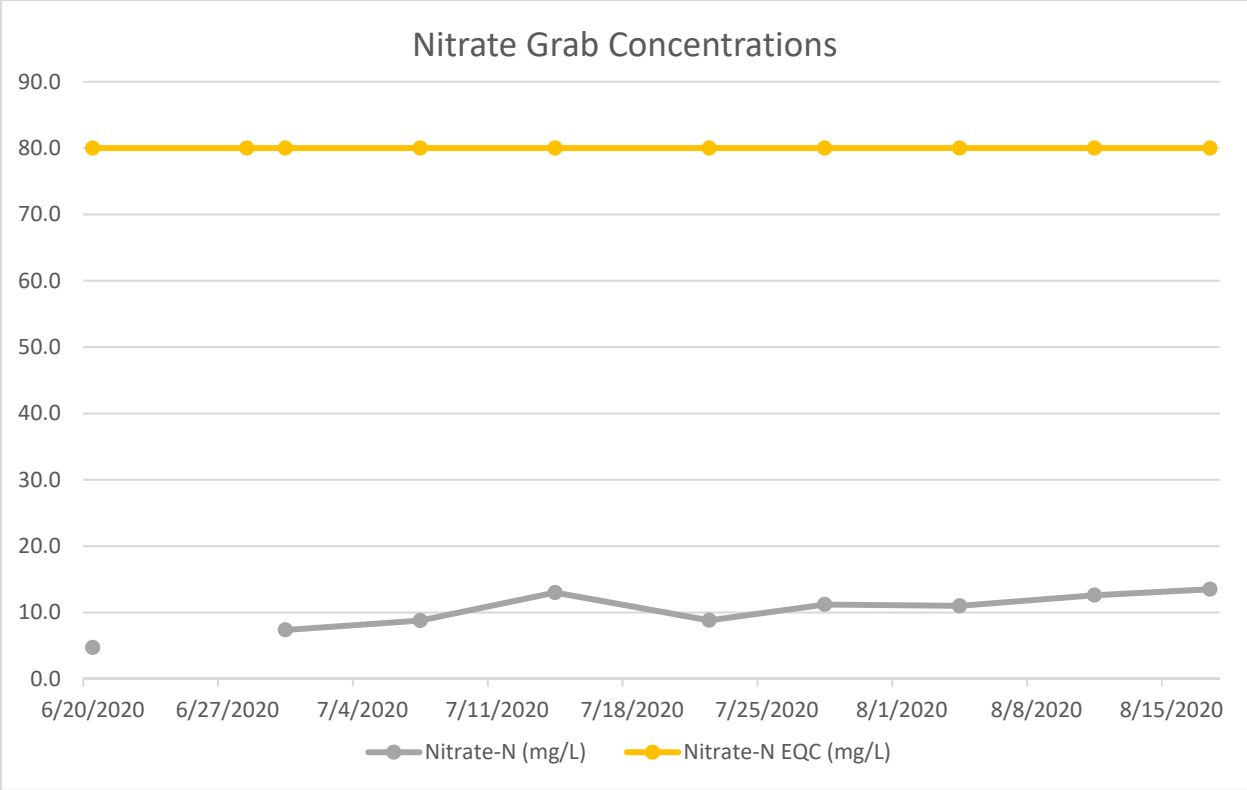

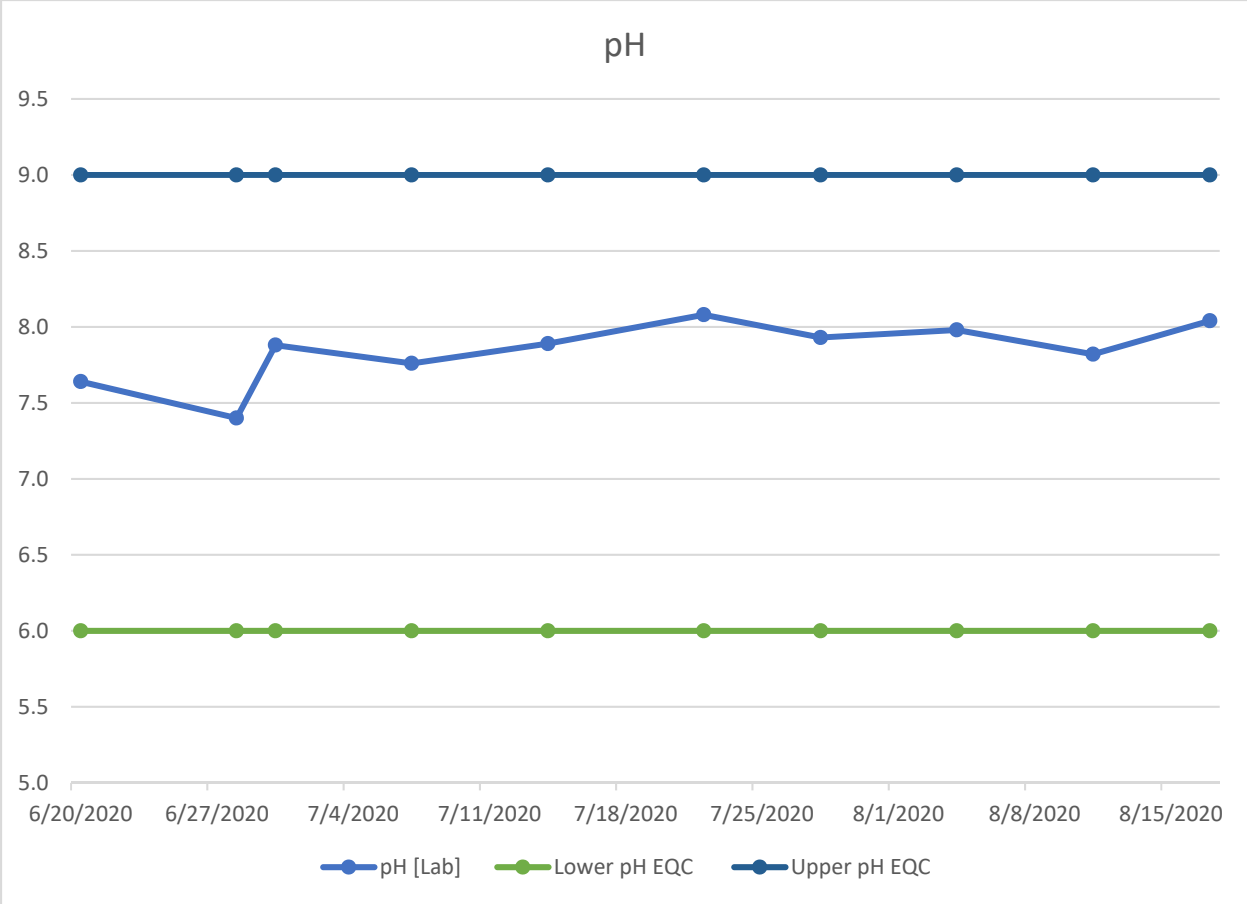

Total Suspended Solids Grab Concentrations

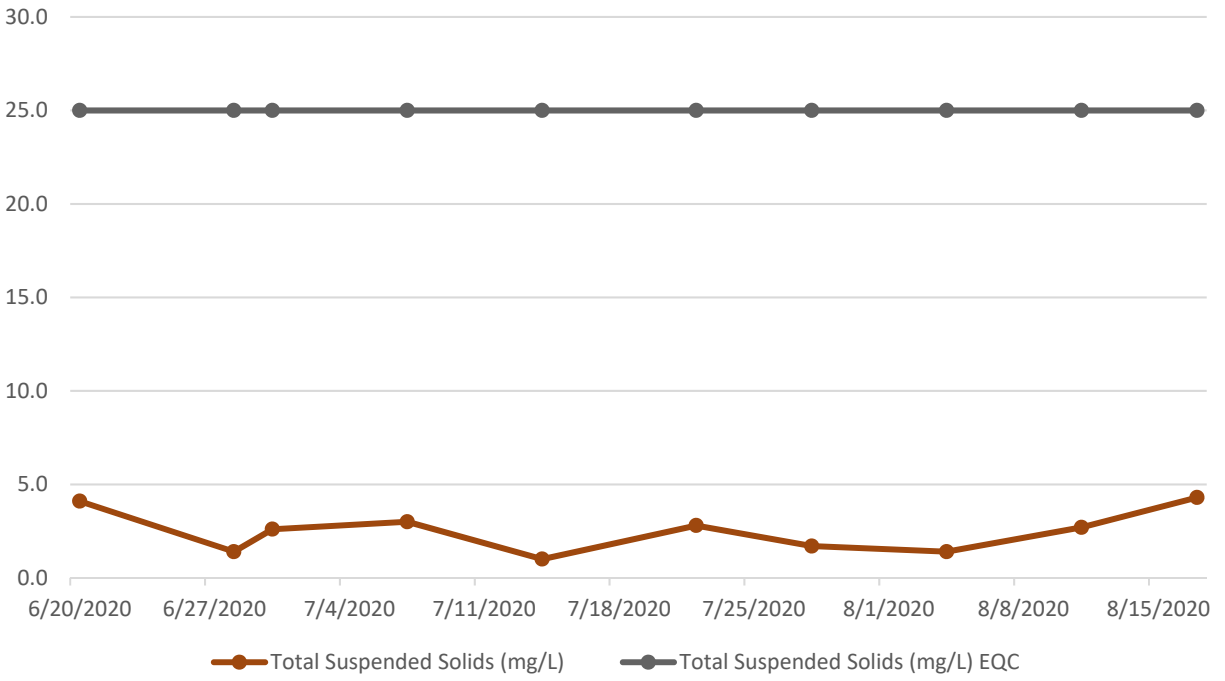

Total Suspended Solids - Average Concentration (4 Consecutive Samples)

